


6/12/07

WILSON

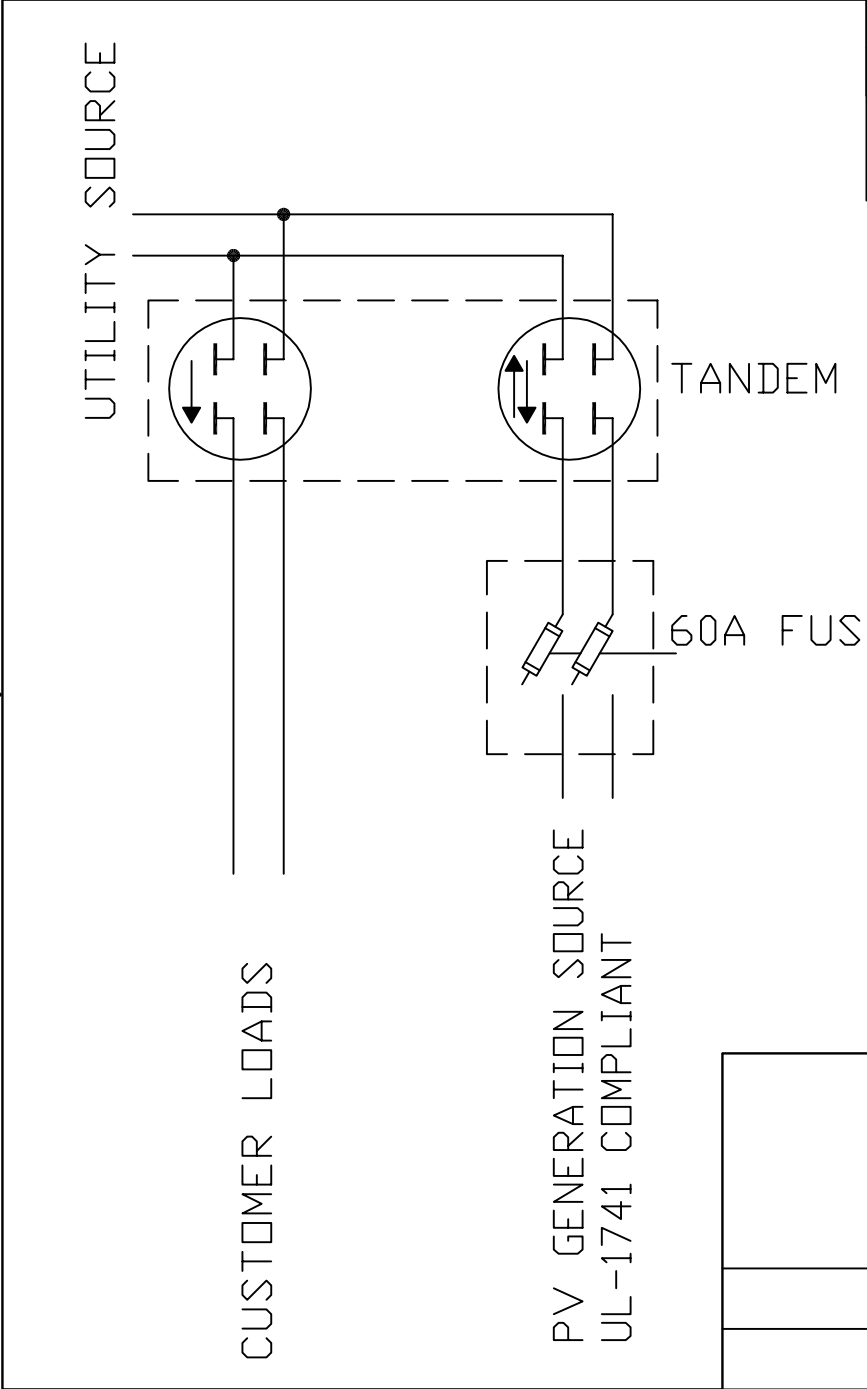

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

TANDEM METER BASE

60A FUSED DISCONNECT

CUSTOMER LOADS

PV GENERATION SOURCE  
UL-1741 COMPLIANT

- NOTES
1. MAXIMUM FUSE SIZE BASED ON WIRE GAUGE.
  2. GENERATION METER TO BE 2 REGISTER, BI-DIRECTIONAL.

		PENINSULA LIGHT COMPANY		
		CUSTOMER GENERATION METERING SCHEMATIC DIAGRAM		
	SIZE	FSCM NO.	DWG NO.	REV 0
	SCALE	NONE		SHEET